


D

C

B

A

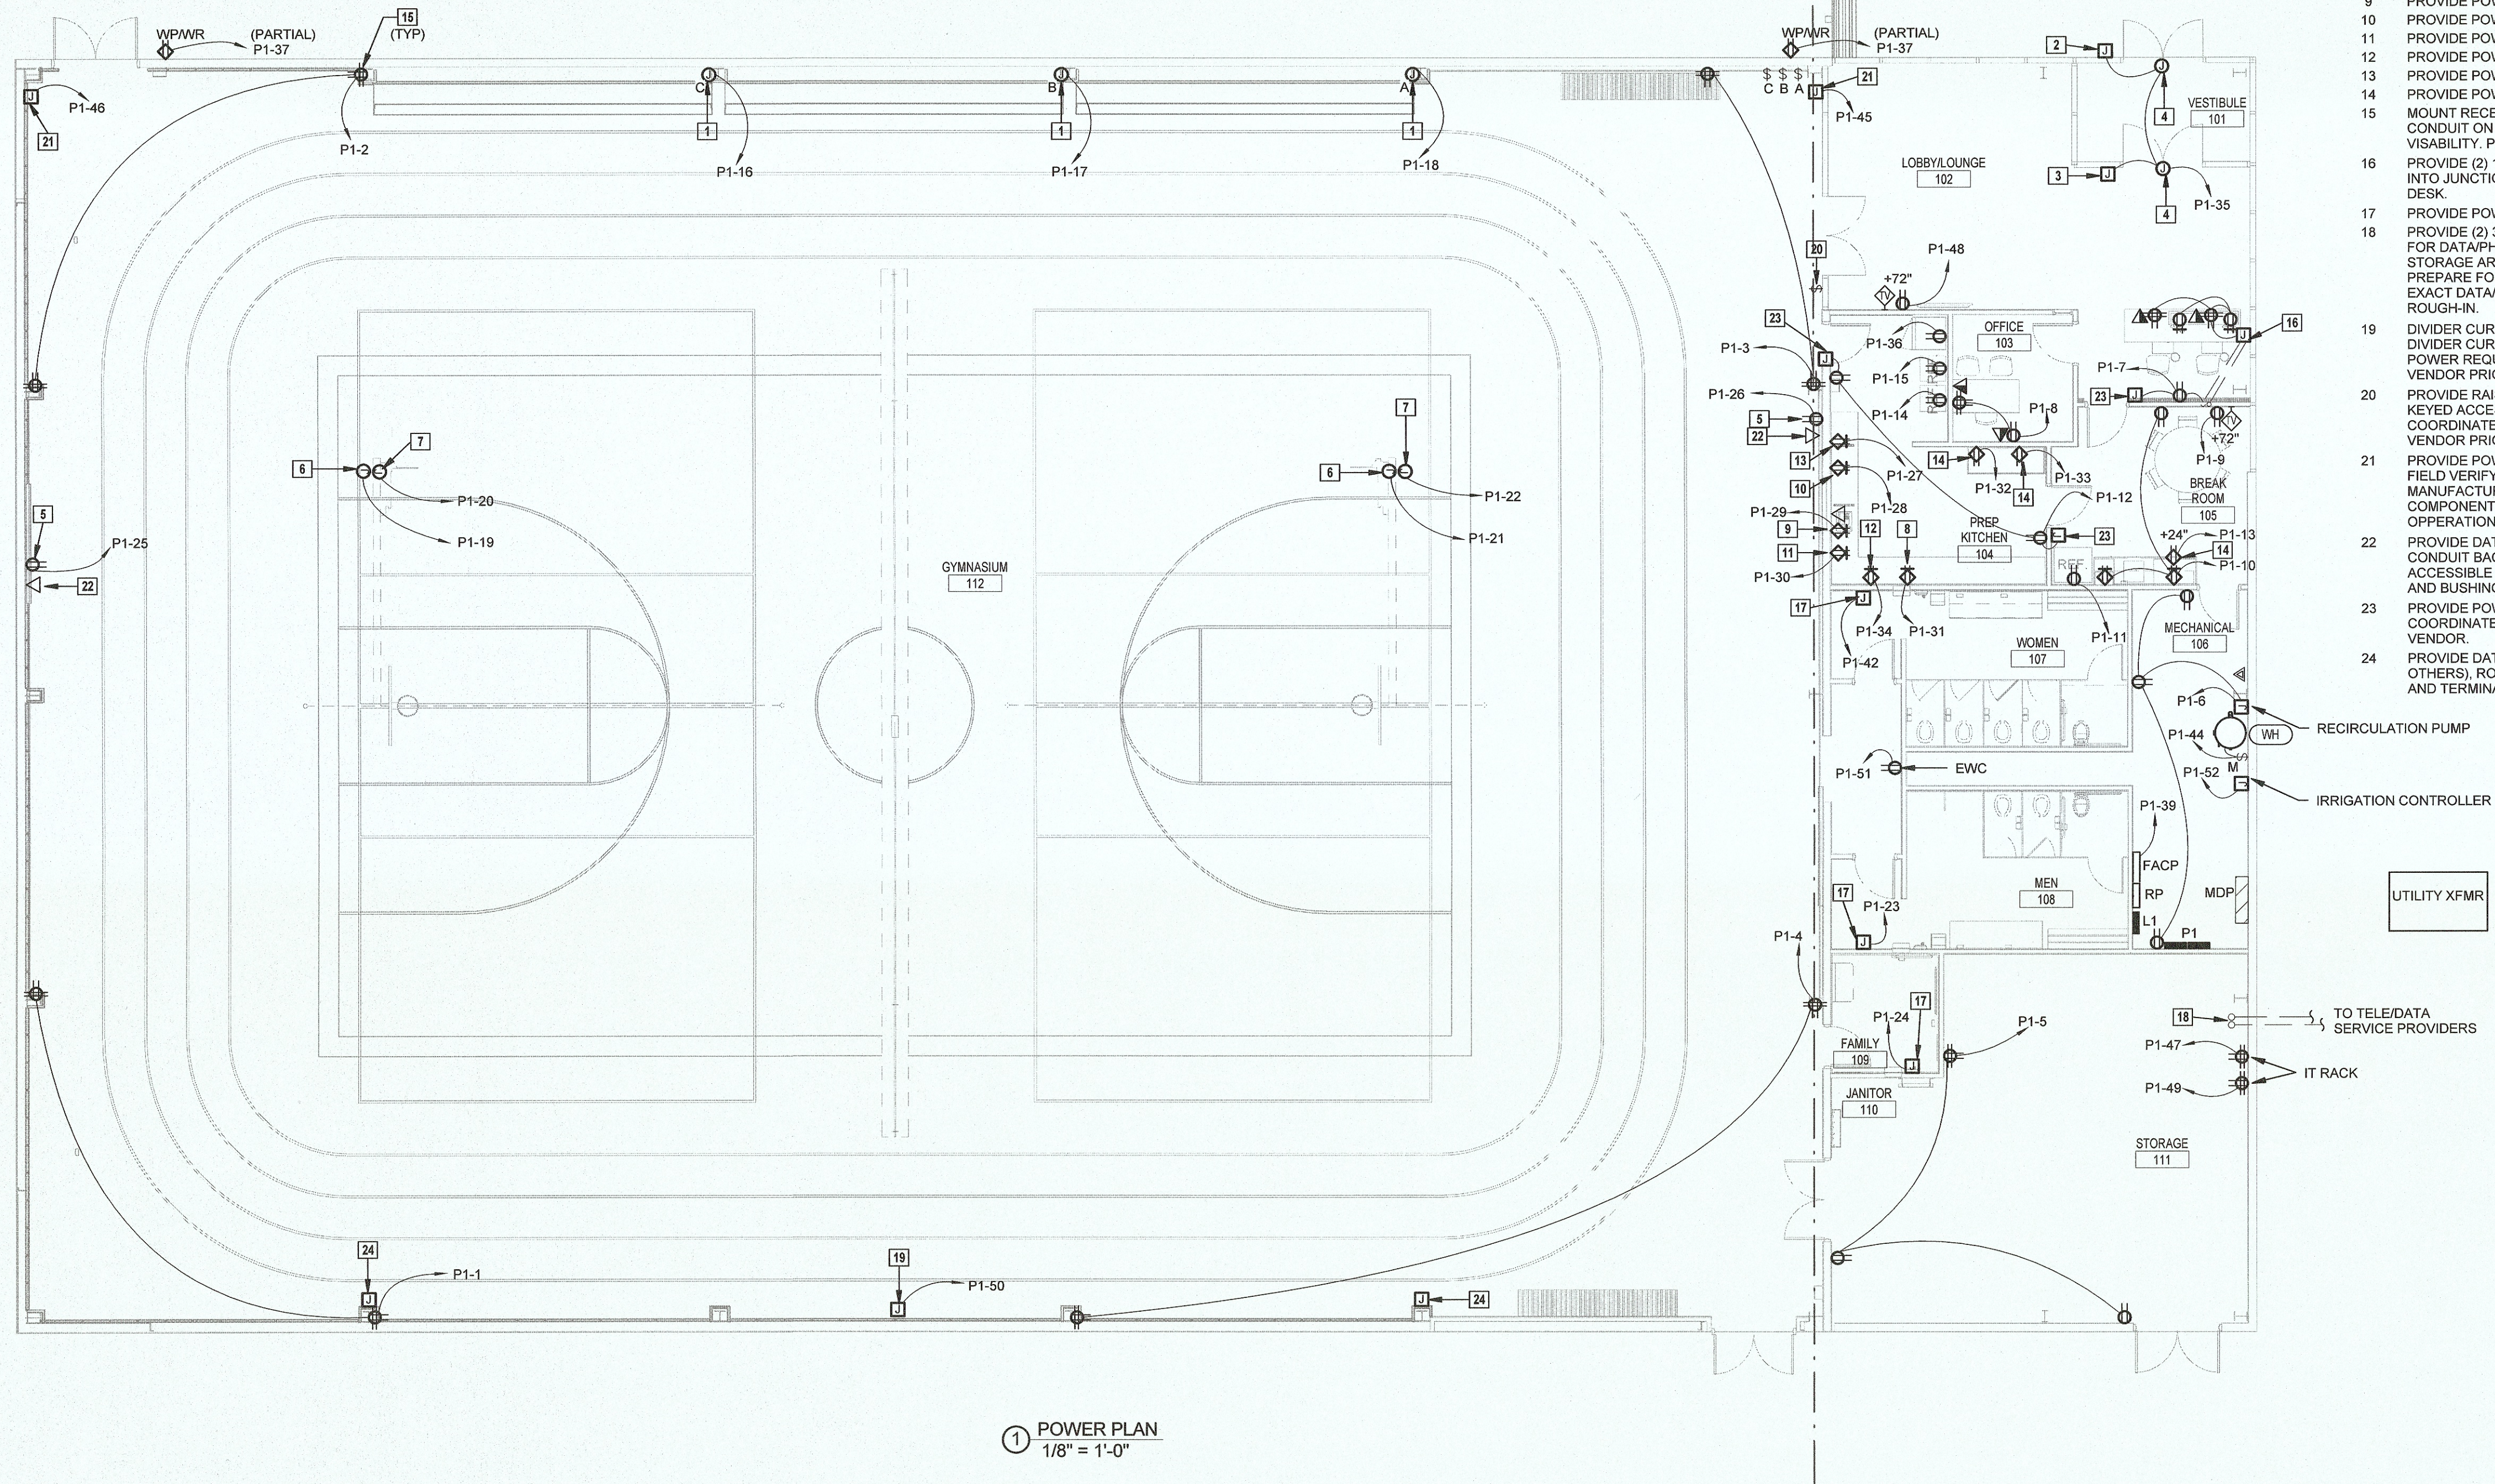

1 POWER PLAN  
1/8" = 1'-0"

ELECTRICAL PLAN NOTES

- 1 RETRACTABLE BLEACHERS. PROVIDE POWER CONNECTION AND DISCONNECT PER EQUIPMENT MANUFACTURER RECOMMENDATIONS. GROUP UP/DOWN PUSH BUTTON SWITCH IN ACCESSIBLE LOCATION WITH OTHER BLEACHER CONTROLS.
- 2 PROVIDE ROUGH-IN FOR CARD READER AND ADA PUSH BUTTON ACCESS ON PEDESTAL (BY ARCHITECT). PROVIDE UNDERGROUND CONDUIT TO INTERIOR DEVICES AND TO ACCESSIBLE SPACE. COORDINATE WITH DOOR ACCESS HARDWARE PROVIDER.
- 3 PROVIDE ROUGH-IN FOR ADA PUSH BUTTON ACCESS AND CONDUIT PATH TO ABOVE ACCESSIBLE CIELING. COORDINATE WITH DOOR ACCESS HARDWARE PROVIDER.
- 4 DOOR ACCESS CONTROLS. MOUNT POWER SUPPLY IN ACCESSIBLE AREA AND COORDINATE WITH DOOR ACCESS HARDWARE INSTALLER.
- 5 SCOREBOARD. COORDINATE FINAL LOCATION AND HEIGHT WITH SCOREBOARD INSTALLER AND OWNER.
- 6 MOTORIZED BASKETBALL GOAL. COORDINATE FINAL MOTOR LOCATION, POWER CONNECTION, AND CONTROL REQUIREMENTS WITH EQUIPMENT MANUFACTURER.
- 7 GOAL HEIGHT ADJUSTER. COORDINATE FINAL MOTOR LOCATION, POWER CONNECTION, AND CONTROL REQUIREMENTS WITH EQUIPMENT MANUFACTURER.
- 8 PROVIDE POWER FOR POPCORN MACHINE.
- 9 PROVIDE POWER FOR POS EQUIPMENT.
- 10 PROVIDE POWER FOR NACHO CHEESE WARMER.
- 11 PROVIDE POWER FOR FOOD WARMING TRAY
- 12 PROVIDE POWER FOR TOASTER OVEN.
- 13 PROVIDE POWER FOR HOT DOG WARMER/ROLLER TRAY.
- 14 PROVIDE POWER FOR MICROWAVE.
- 15 MOUNT RECEPTACLE TO STRUCTURAL STEEL. RUN CONDUIT ON INSIDE FLANGE OF STEEL TO MINIMIZE VISABILITY. PAINT TO MATCH STEEL.
- 16 PROVIDE (2) 1" CONDUITS FOR POWER AND DATA. STUB UP INTO JUNCTION BOX FOR CONNECTION TO RECEPTION DESK.
- 17 PROVIDE POWER FOR HAND DRYER.
- 18 PROVIDE (2) 3" CONDUIT AND PULL STRING AS REQUIRED FOR DATA/PHONE WIRING TO D-MARK LOCATION IN STORAGE AREA. ROUTE CONDUIT INTO SPACE, CAP, AND PREPARE FOR FUTURE SERVICE PROVIDER. FIELD VERIFY EXACT DATA/PHONE SERVICE ENTRANCE PRIOR TO ROUGH-IN.
- 19 DIVIDER CURTAIN. PROVIDE POWER CONNECTION TO DIVIDER CURTAIN WENCH MOTOR. COORDINATE EXACT POWER REQUIREMENTS AND LOCATION WITH EQUIPMENT VENDOR PRIOR TO INSTALLATION.
- 20 PROVIDE RAISE/LOWER MOTOR RATED PUSH BUTTON WITH KEYED ACCESS FOR CONTROL OF DIVIDER CURTAIN. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT VENDOR PRIOR TO INSTALLATION.
- 21 PROVIDE POWER FOR MOTORIZED SHADES AT WINDOWS. FIELD VERIFY POWER REQUIREMENTS WITH EQUIPMENT MANUFACTURER AND PROVIDE ALL NECESSARY COMPONENTS AND ACCESSORIES FOR PROPER OPERATION.
- 22 PROVIDE DATA BACK BOX FOR SCOREBOARD. ROUTE 1/2" CONDUIT BACK TO PREP KITCHEN. TERMINATE ABOVE ACCESSIBLE CEILING, AND PROVIDE WITH PULL STRING AND BUSHING.
- 23 PROVIDE POWER CONNECTION FOR CARD READER. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT VENDOR.
- 24 PROVIDE DATA BACK BOX FOR WIFI ROUTER (PROVIDED BY OTHERS). ROUTE 1/2" CONDUIT BACK TO STORAGE ROOM AND TERMINATE ABOVE IT RACK LOCATION.